



SIDEWALK DETAIL

PERMIT REQUIRED


DISTANCE BETWEEN CONTRACTION JOINTS SHALL BE EQUAL TO SIDEWALK WIDTH

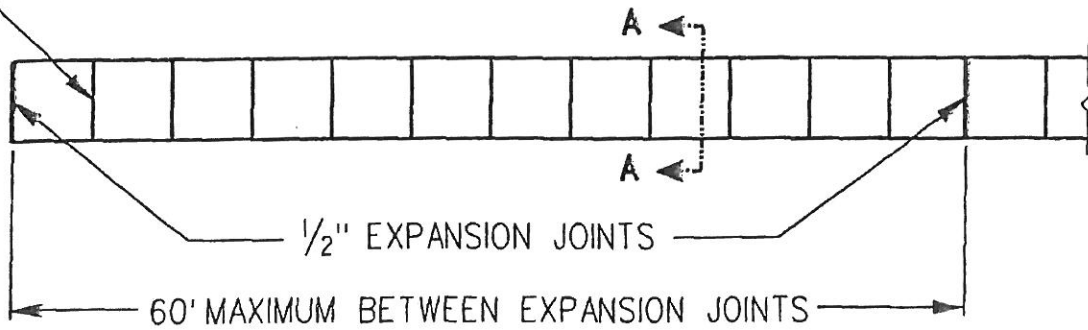





MINIMUM 1/4" PER FOOT ABOVE TOP OF CURB

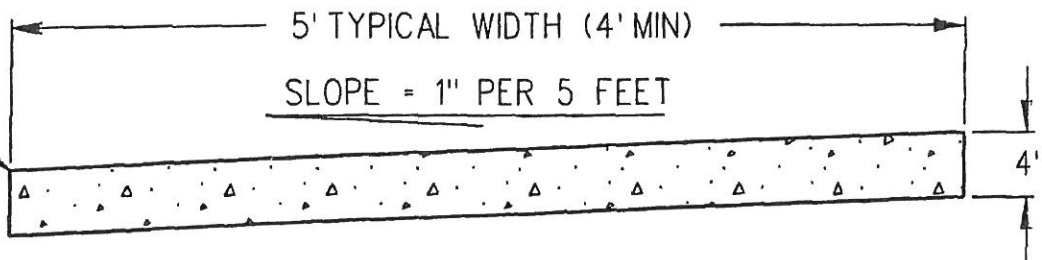



SECTION A-A

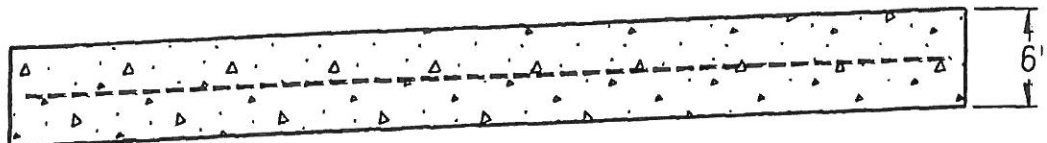

SIDEWALK ACROSS DRIVE APPROACH SHALL BE 6\" CONCRETE
WITH 6\" x 6\" x #6 x #6 WIRE MESH REINFORCING

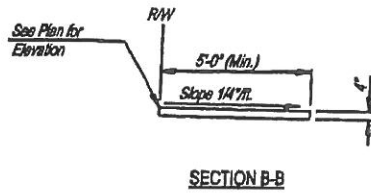
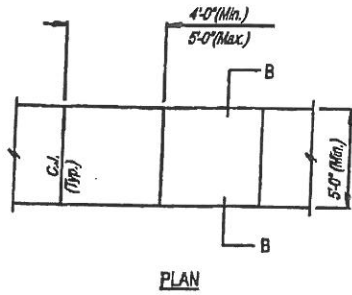


SIDEWALK DETAILS

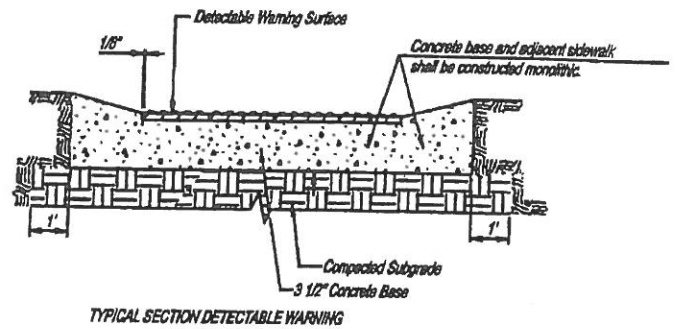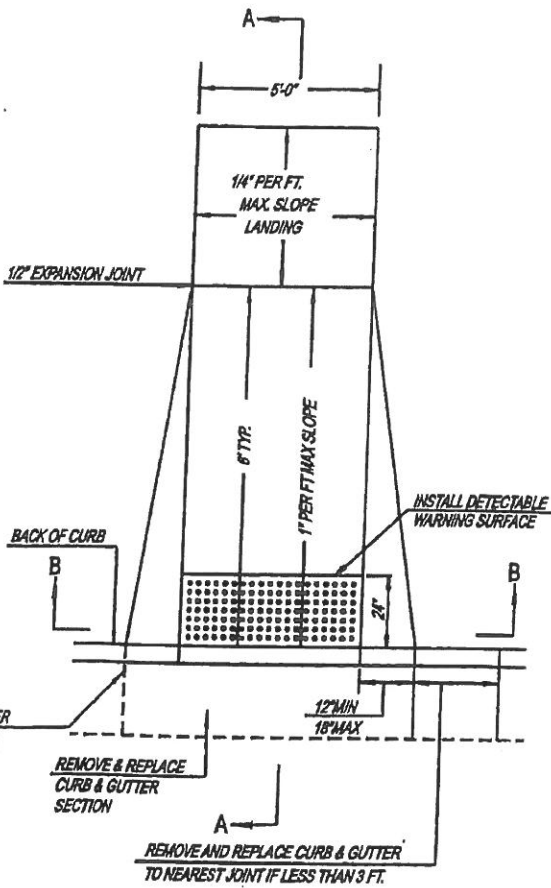

NOTE: RAMPS TO COMPLY WITH LATEST ADAAG GUIDELINES. THE DETECTABLE WARNING SURFACE SHALL BE ADA SOLUTIONS "CAST-IN-PLACE" PANELS OR APPROVED EQUIVALENT INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. THE PANELS SHALL BE YELLOW IN COLOR.

SECTION B-B

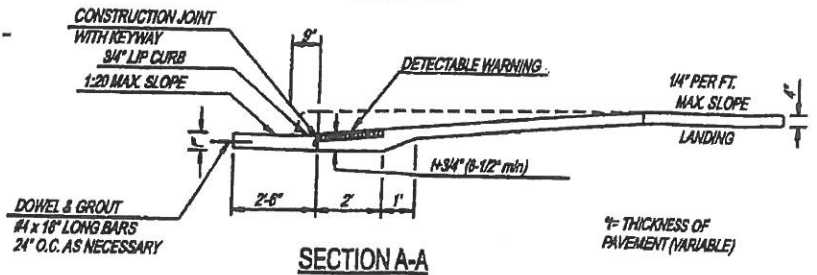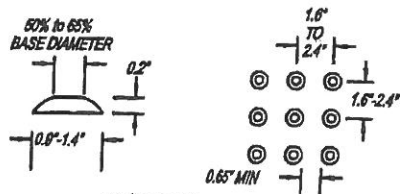

(TYPE A)
STANDARD WHEELCHAIR RAMP
WITH DETECTABLE WARNING
CONSTRUCTION DETAIL FOR STREETS
WITH COMBINED CURB & GUTTER

TYPICAL WHEELCHAIR RAMP DETAILS

t = THICKNESS OF PAVEMENT (VARIABLE)